work of providing, laying 100mm dia DI water supply pipeline in place of 75mm/100mm dia,corroded CI line in Rayapuram B street,C street,E street and harikunte 2nd cross and surrounding areas to reduce contamination and freequent leak under Jagajeevanram nagar Service station of AEE SW2 Sub-Division area:

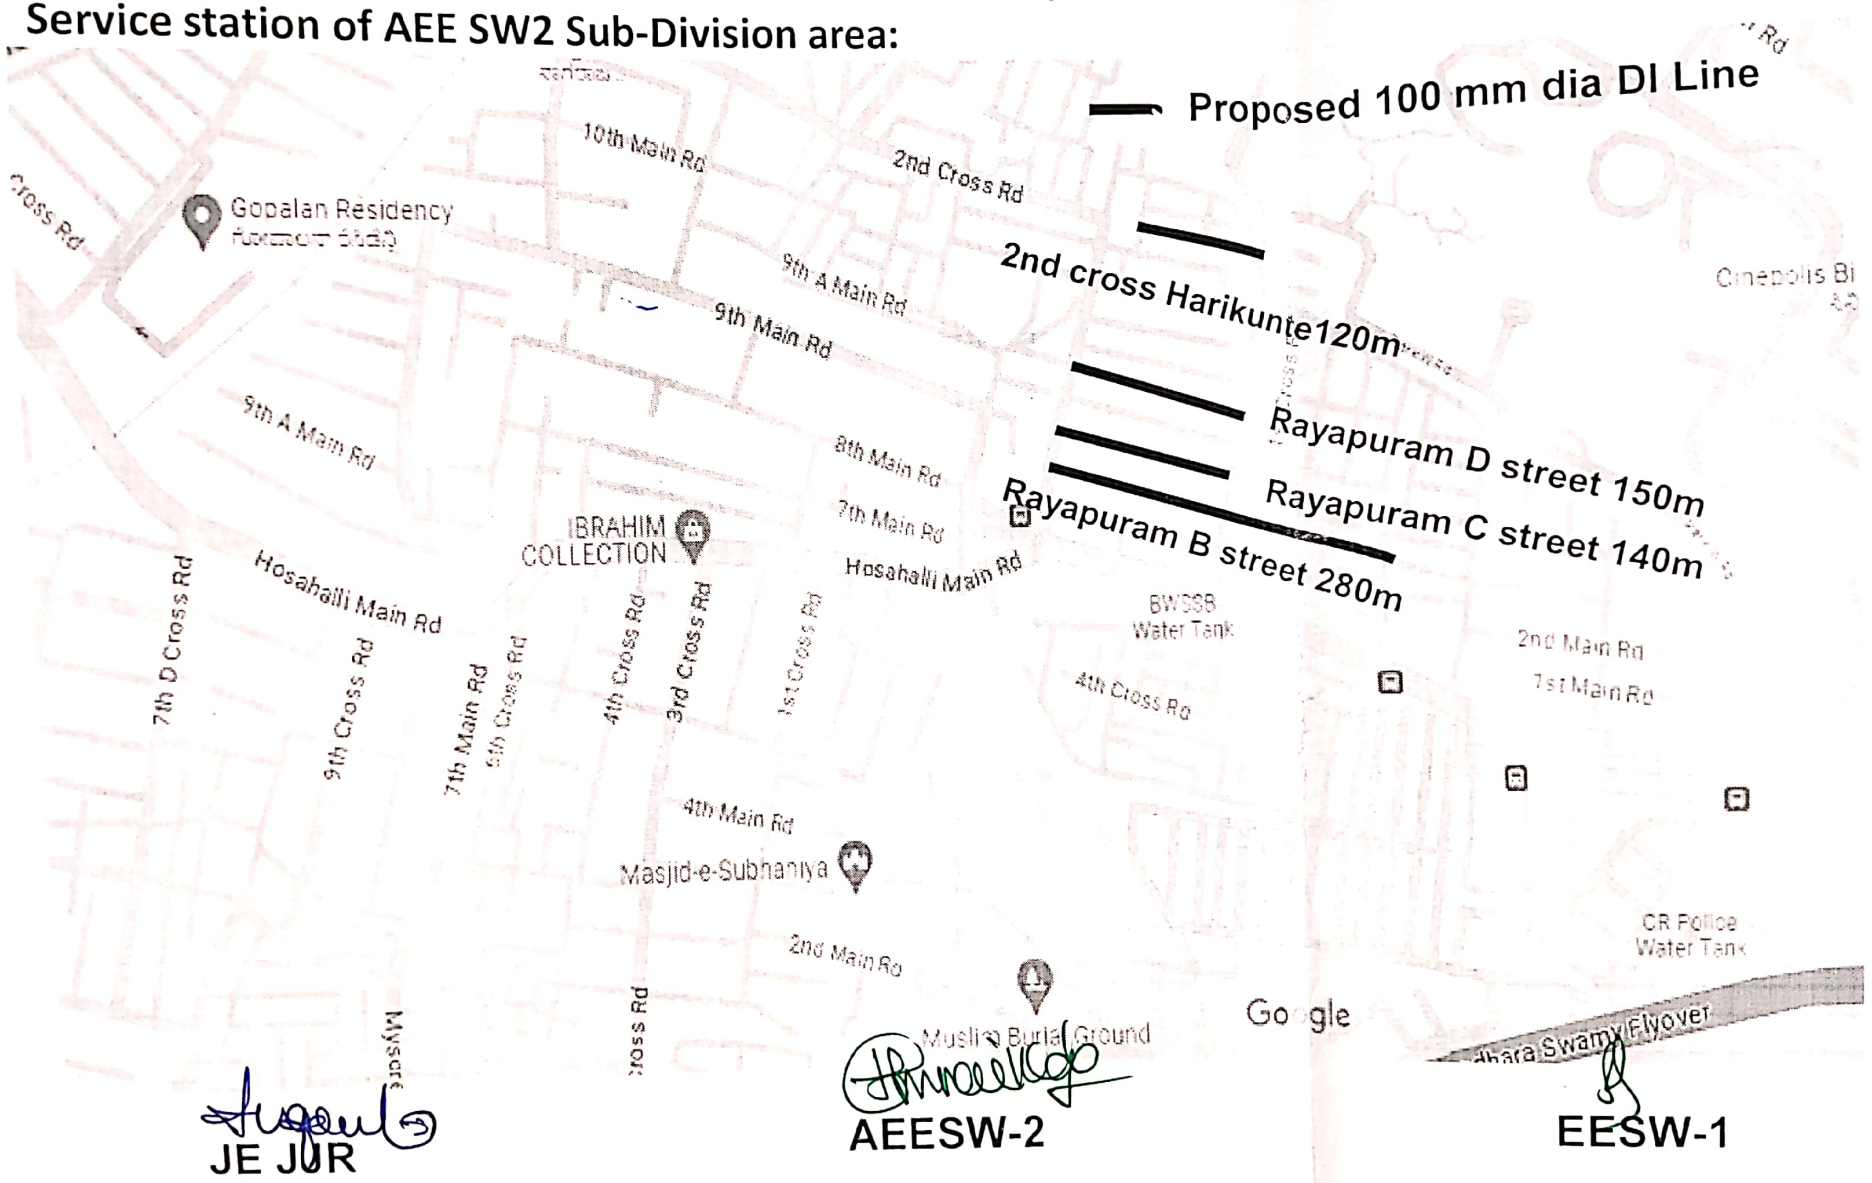

JE JJR

AEESW-2

EESW-1

Scanned with OKEN Scanner

work of providing, laying 100mm dia DI water supply pipeline in place of 75mm/100mm dia,corroded CI line in Rayapuram B street,C street,E street and harikunte 2nd cross and surrounding areas to reduce contamination and freequent leak under Jagajeevanram nagar Service station of AEE SW2 Sub-Division area: